

## **ADDENDUM NO. 3**

### **TRACK & FIELD IMPROVEMENTS – INC 2**

LITTLE JOB #612-12353-03

DSA: A# 03-120009 File #56-H4

#### **Pacifica High School**

600 E. Gonzales Road.  
Oxnard, CA. 93036

September 08, 2020

#### **LITTLE**

1300 Dove Street, Suite 100  
Newport Beach, CA 92660



Architect- Jay R. Tittle, C- 12955

## **1. PART 1 - GENERAL**

- 1.1.** The following revisions and/or clarifications shall be made to the Bidding Requirements and Contract Documents. Revise and amend the Documents for the above named project in accordance with this Addendum. The bid shall reflect these addendum changes and each bidder shall make reference in their bid to this addendum.
- 1.2.** All Bidding Requirements and Contract Documents shall apply to this addendum as originally indicated in the applicable portions of the contract documents, unless otherwise modified by this addendum.
  - 1.2.1.** Previous Addendum #0 issued August 07, 2020; clarifying the bid scope for all bidders.
  - 1.2.2.** Previous Addendum #1 issued August 07, 2020.
  - 1.2.3.** Previous Addendum #2 issued August 27, 2020.
- 1.3. GENERAL CLARIFICATIONS**
  - 1.3.1.** The following clarifications are issued to all bidders as information for use in preparing bids:
    - 1.3.1.1.** Add sheet E-100 (AD3-E2), Overall Electrical Site Plan – Pacifica HS Track & Field INC 1, DSA A# 03-120009 INC1 for reference noting the existing panel schedule.

**1.4. CHANGES TO PREVIOUS ADDENDA**

**1.4.1.** Addendum No. 1, dated August 07, 2020, Item 3.1.1.1:

**1.4.1.1.** Modify Item 3.1.1.1: 'Drawing G.0.1.1' to read as '**Drawing G1.1**'

**END OF ADDENDUM #3**

**Enclosures:**

- l) Reference Plans Issued:
  - a) E-100 – Overall Electrical Site Plan (INC 1) – DSA A# 03-120009 INC1



PANELBOARD: SLP (EXISTING)

BUS AMPS: 125A  
MAIN SIZE/TYPE: 125A MCB  
VOLTS/PHASE: 208Y/120V, 3PH, 4W  
SECTION: 1

FAULT CURRENT: REFER TO ONE-LINE DIAGRAM  
AIC RATING: 10000 FULLY RATED  
SERVES: FIELD AREA  
MOUNTING: SURFACE  
LOCATION: FIELD AREA


NEMA 3R

CKT NO.	DESCRIPTION	VOLTAMPS/PHASE			WIRE NO.	BKR AMP	P	BKR AMP	WIRE NO.	VOLTAMPS/PHASE			DESCRIPTION	CKT NO.
		A	B	C						A	B	C		
1	EXISTING LOAD	900				20	1	1	20	900			EXISTING LOAD	2
3	EXISTING LOAD		900			20	1	1	20		900		EXISTING LOAD	4
5	EXISTING LOAD			900		20	1	1	20			900	EXISTING LOAD	6
7	EXISTING LOAD	900				20	1	1	20	900			EXISTING LOAD	8
9	EXISTING LOAD		900			20	1	1	20		900		EXISTING LOAD	10
11	EXISTING LOAD			900		20	1	1	20			900	EXISTING LOAD	12
13	EXISTING LOAD	900				20	1	1	20	900			EXISTING LOAD	14
15	EXISTING LOAD		900			20	1	1	20		900		EXISTING LOAD	16
17	EXISTING LOAD			900		20	1	1	20			900	EXISTING LOAD	18
19	EXISTING LOAD	900				20	1	1	20	900			EXISTING LOAD	20
21	EXISTING LOAD		900			20	1	1	20		900		EXISTING LOAD	22
23	EXISTING LOAD			900		20	1	1	20			900	EXISTING LOAD	24
25							1	1						26
27							1	1						28
29							1	1						30
31	SCORE BORAD	1,500				20	2	1						32
33			1,500				1							34
35	FIELD JUNCTION BOX			1,200		20	1	1	20			1,200	FIELD JUNCTION BOX	36
37	FIELD JUNCTION BOX	1,200				20	1	1	20	1,200			FIELD JUNCTION BOX	38
39	FIELD JUNCTION BOX		1,200			20	1	1	20		1,200		FIELD JUNCTION BOX	40
41	FIELD JUNCTION BOX			1,200		20	1	1	20			1,200	FIELD JUNCTION BOX	42
SUBTOTAL		6,300	6,300	6,000						4,800	4,800	5,100	SUBTOTAL	
TOTAL PHASE A - VA		11,100				DF								
LOAD														
AMPS		93				1.00								
TOTAL PHASE B - VA		11,100				0								
LOAD														
AMPS		93				1.25								
TOTAL PHASE C - VA		11,100				1.0/5								
LOAD														
AMPS		93				1.00								
TOTAL PNLBD - VA		33,300				1.00							TOTAL DEMAND	
LOAD														
AMPS		92				1.00							33,300 VA	
													92 A	

PANELBOARD NOTES

EXISTING PANEL SCHEDULE 'SLP'

SCALE: NONE

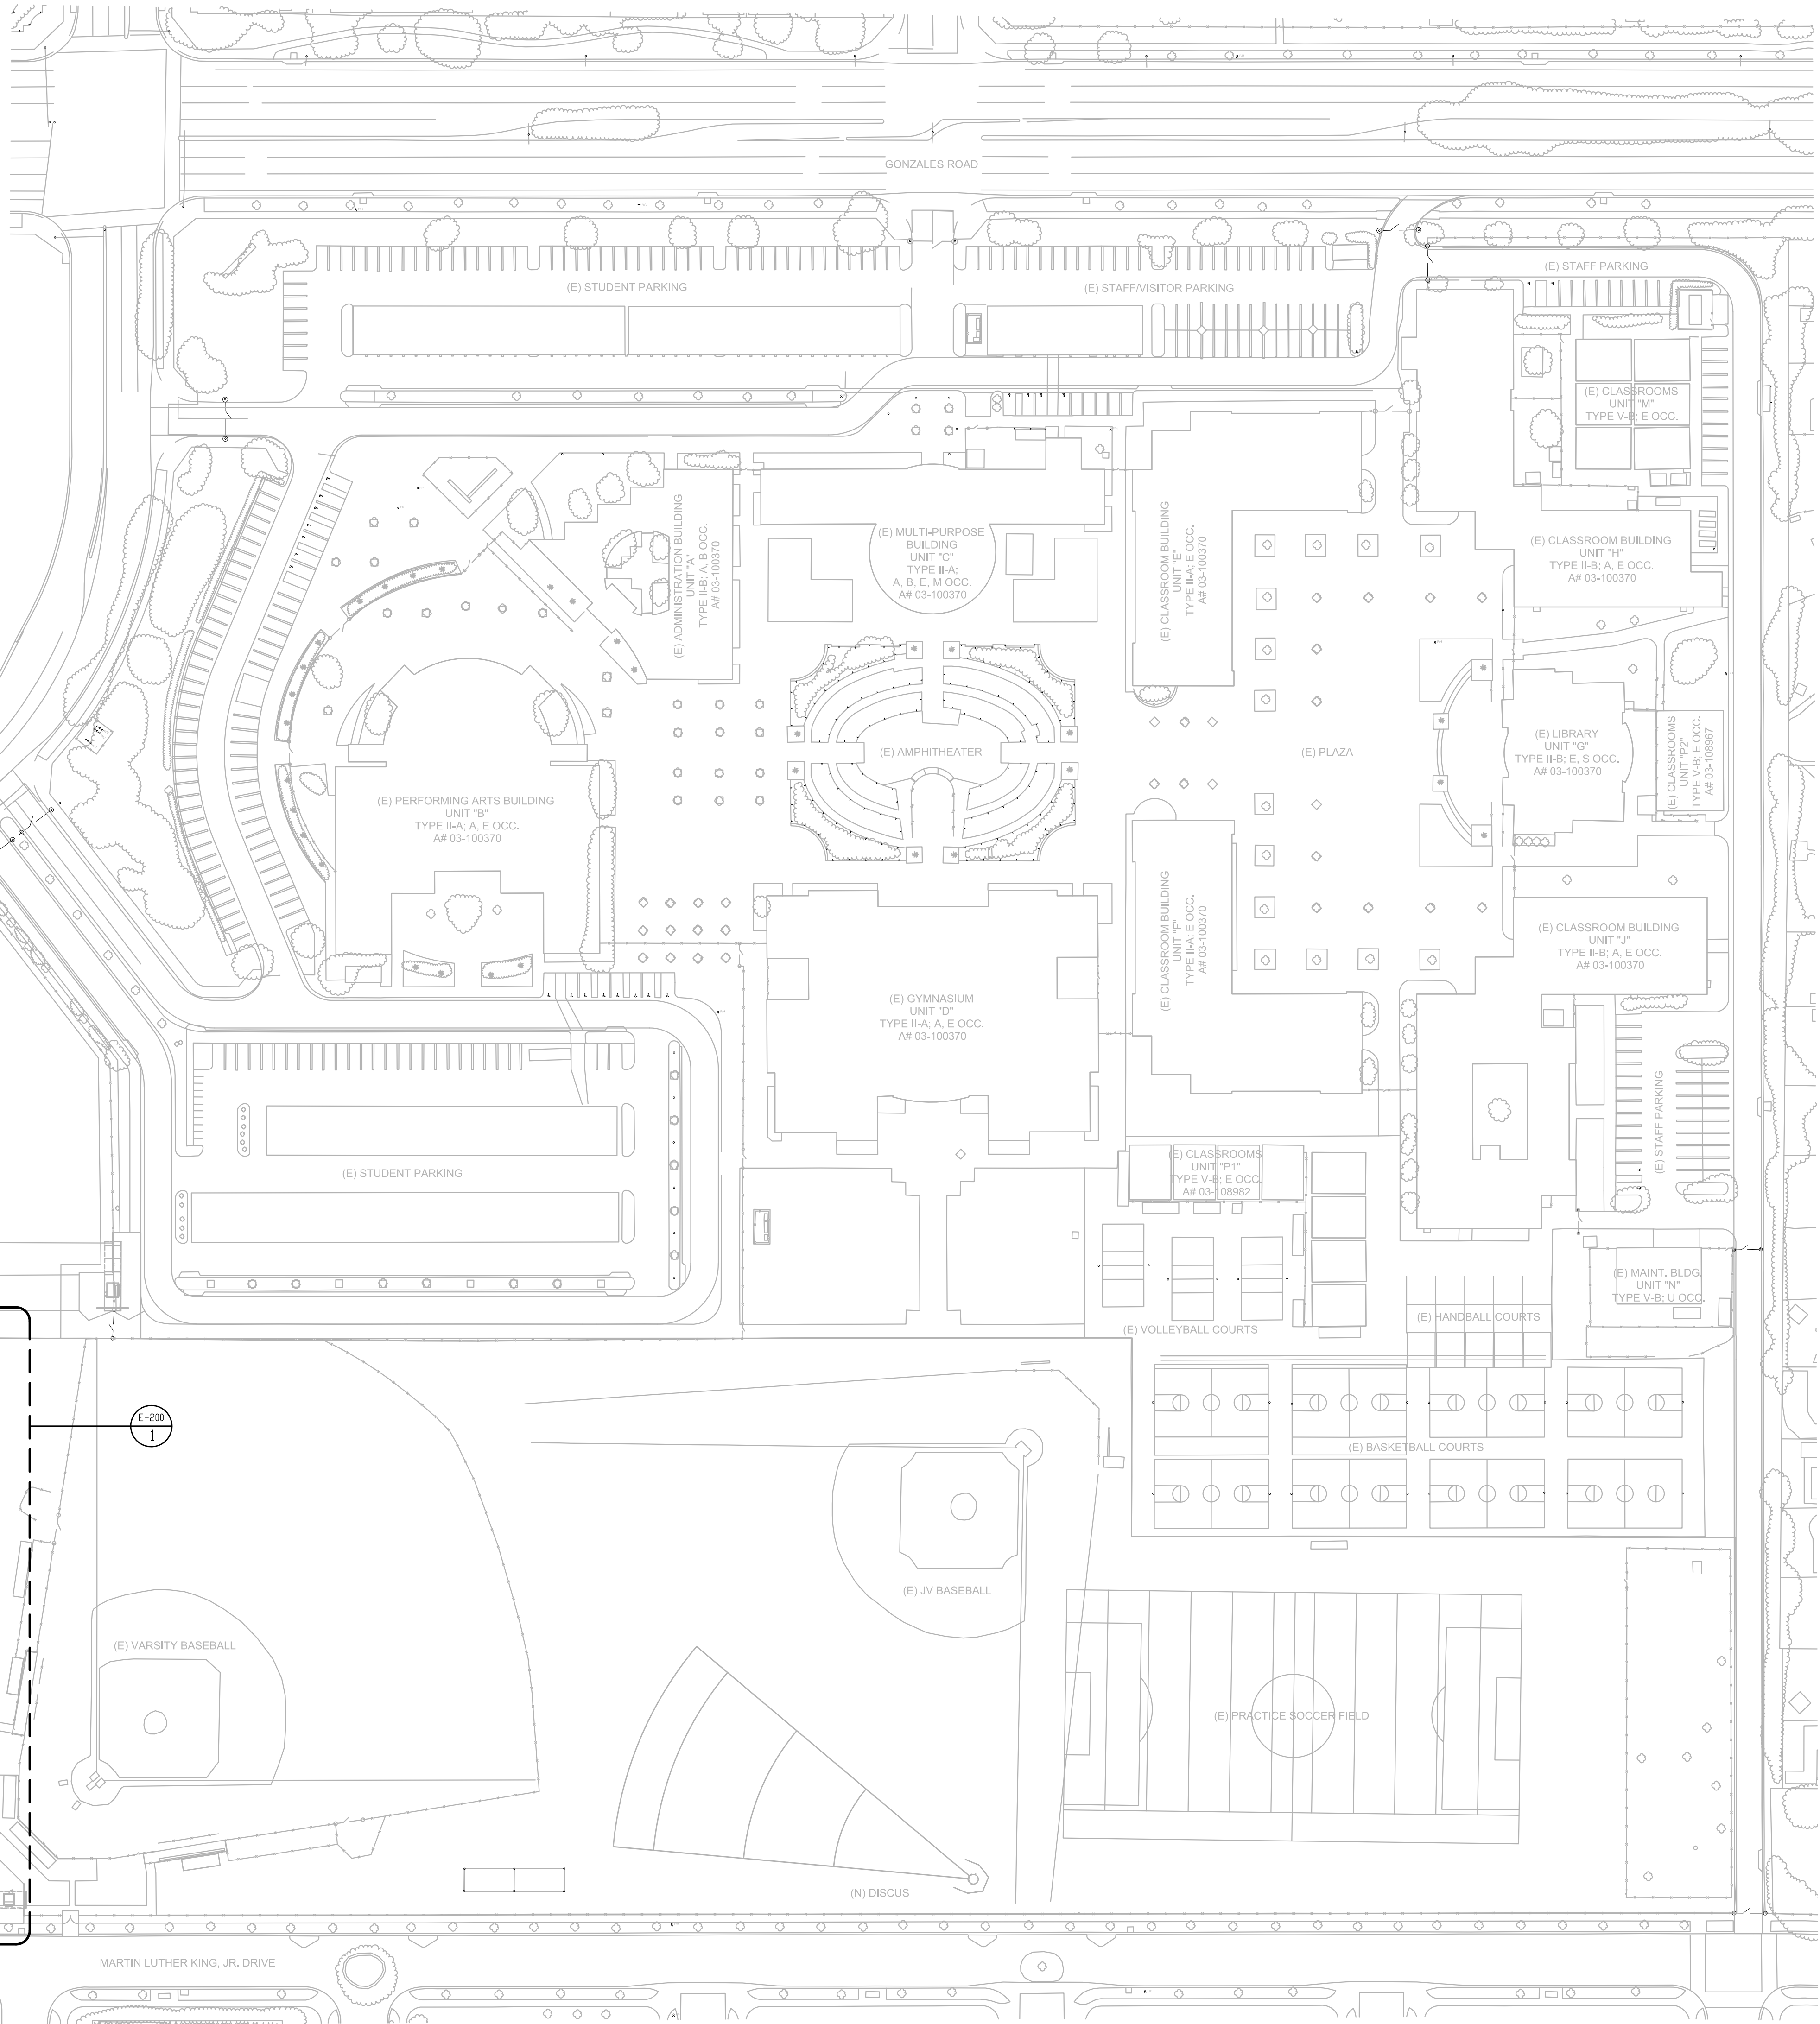

APPROVED  
DIV. OF THE STATE ARCHITECT  
APP. 03-120009 INC. 1  
REVIEWED FOR  
SS ☒ FLS ☒ ACS ☒  
DATE: 5/7/2020

**LITTLE**  
DIVERSIFIED ARCHITECTURAL CONSULTING



www.littleonline.com

This drawing and the design shown are the property of Little Diversified Architectural Consulting. The reproduction, copying or other use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.  
© Little 2019

OXNARD UNION  
HIGH SCHOOL  
DISTRICT

PACIFICA HIGH SCHOOL TRACK & FIELD  
IMPROVEMENTS - INC 1

600 E. GONZALES RD,  
OXNARD, CA. 93036

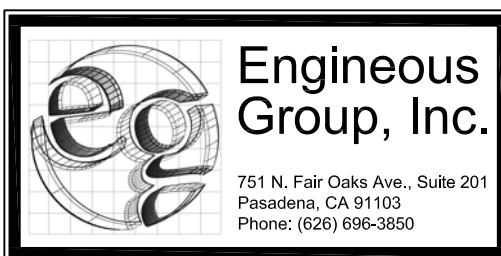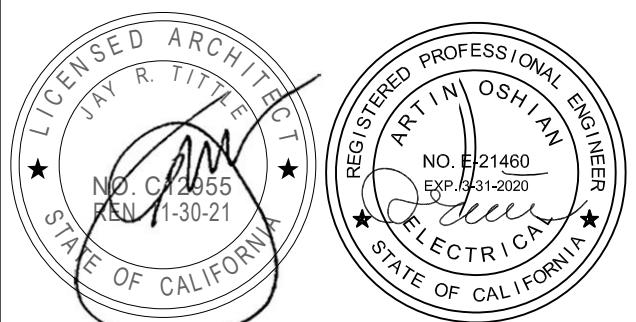

12/03/19		
NO.	REASON	DATE
3	ADDENDUM	12/03/19

PRINCIPAL IN CHARGE  
B.E.S.  
PROJECT MANAGER  
A.O.  
DESIGN TEAM  
J.H.

PACIFICA HIGH SCHOOL  
TRACK & FIELD  
IMPROVEMENTS - INC 1

612-12353-03

OVERALL ELECTRICAL  
SITE PLAN

ISSUED WITH ADDENDUM 3 - FOR REFERENCE ONLY

OVERALL ELECTRICAL SITE PLAN

SCALE: 1/8"=1'-0"

1

(E-100) AD3-E2